


Q DIAL TO BE 4' TO 5' ABOVE GROUND
AND 2' FROM CORNER FACING STREET

SEAL
(By DOW)

#19-3 STRAND SHEILDED WIRE

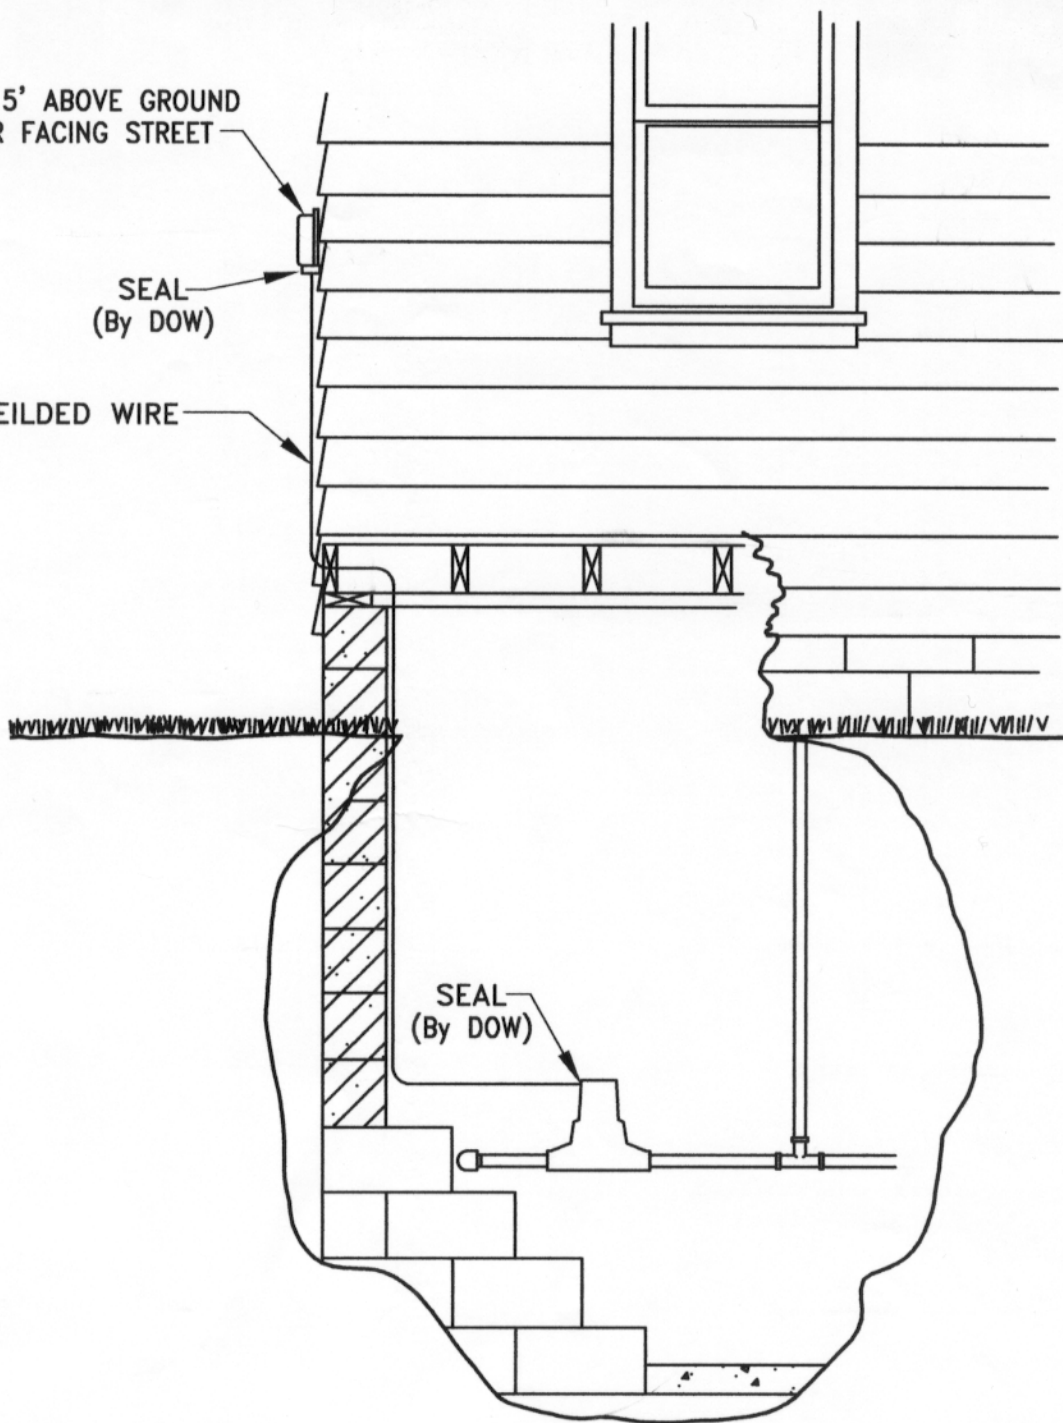

GENERAL NOTES:

INSTALLATION, LOCATION, COST
AND MAINTENANCE SHALL BE IN
ACCORDANCE WITH DIV. OF WATER
RULE & REGULATION 96-1.

CITY OF COLUMBUS
DEPARTMENT OF PUBLIC UTILITIES
DIVISION OF WATER

APPROVED:

ENGINEER

Jeff Hubbard

4/1/01
DATE

STANDARD DETAIL
EXTERIOR WATER METER REGISTER

L-6101